




**MOUNTABLE KERB**  
N.T.S

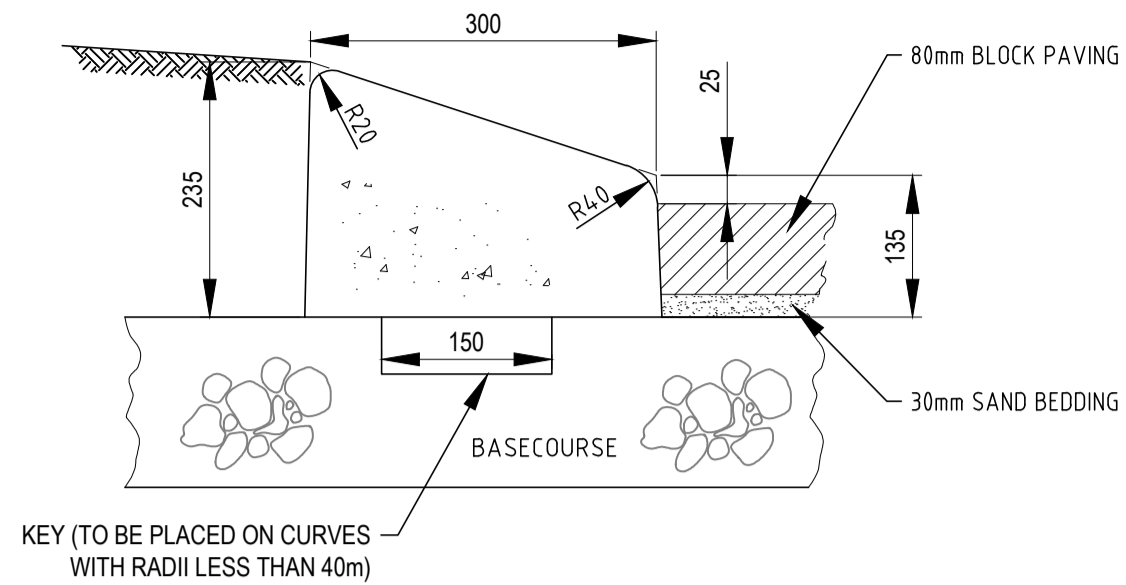


**MOUNTABLE KERB FOR BLOCK PAVING**  
N.T.S

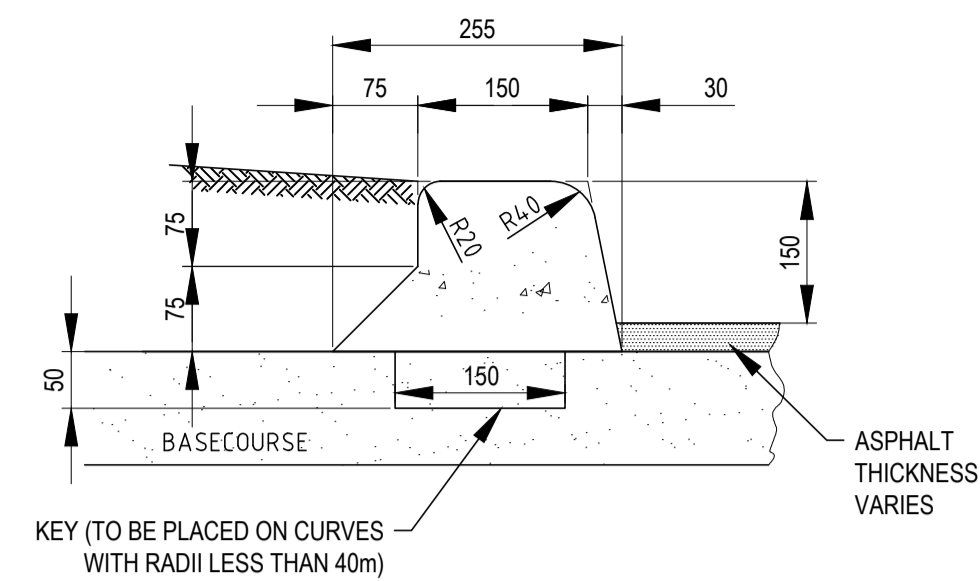


**BARRIER KERB**  
N.T.S

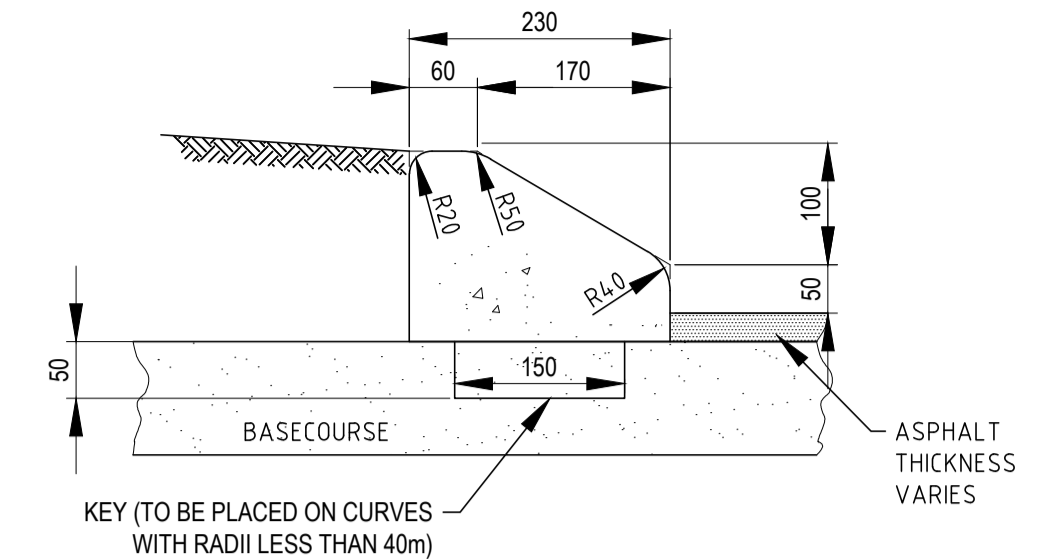


**SEMI MOUNTABLE KERB**  
N.T.S

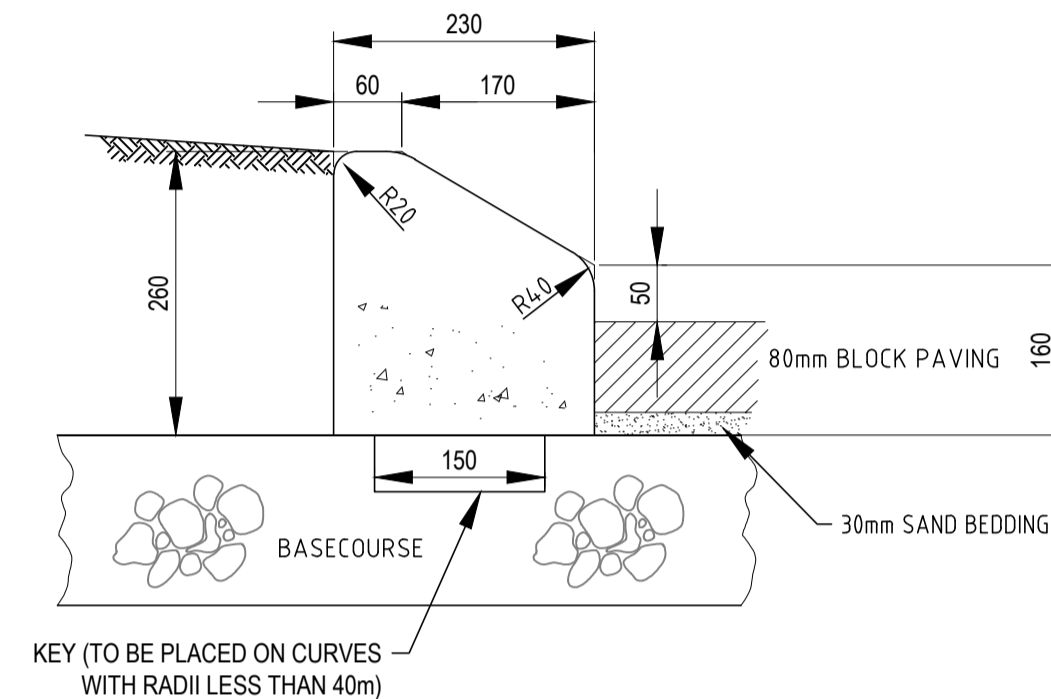


**SEMI MOUNTABLE KERB FOR BLOCK PAVING**  
N.T.S

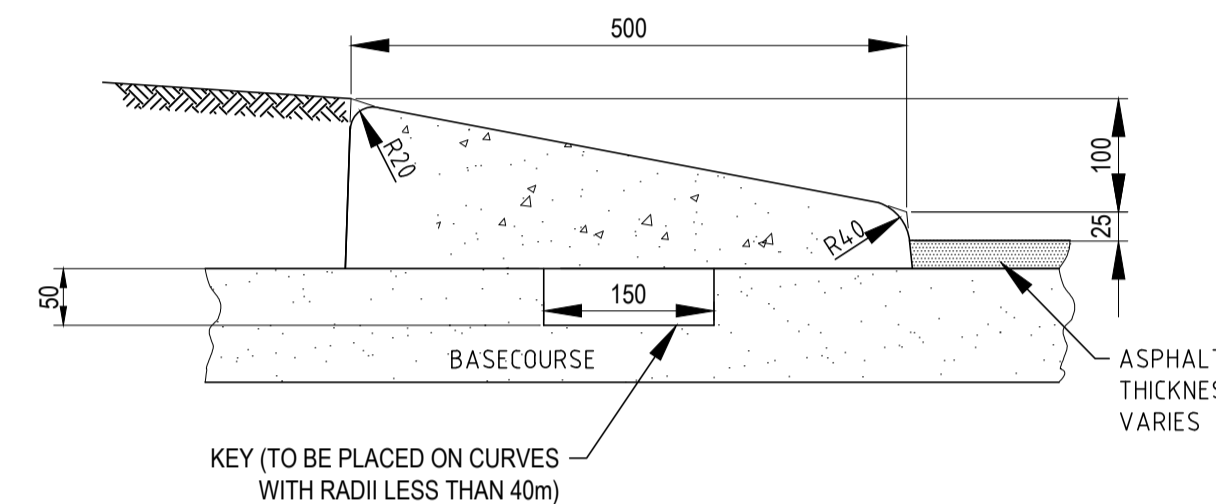


**LAYBACK KERB**  
N.T.S

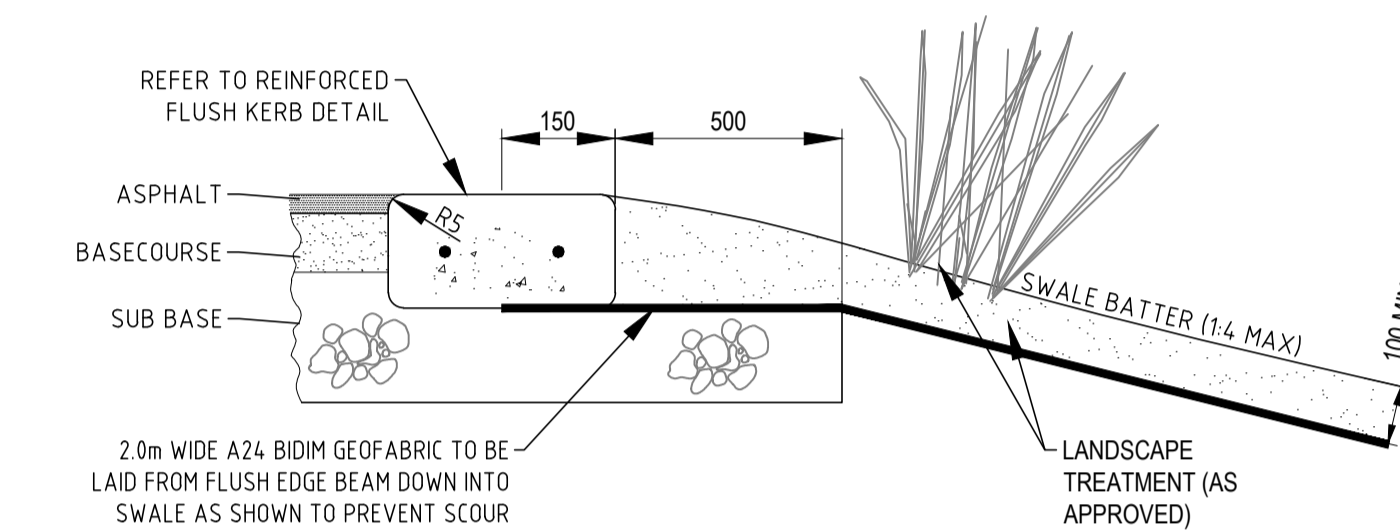


**REINFORCED FLUSH KERB - SWALE SCOUR PROTECTION DETAIL**  
N.T.S

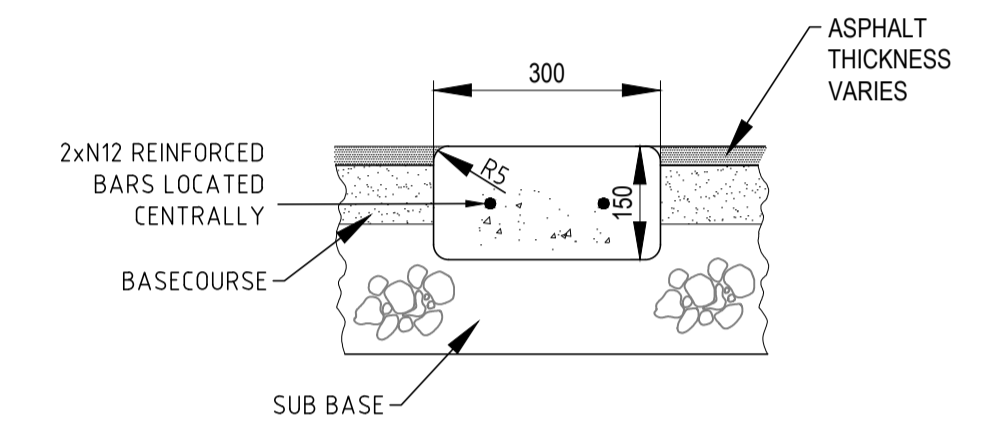


**REINFORCED FLUSH KERB**  
N.T.S

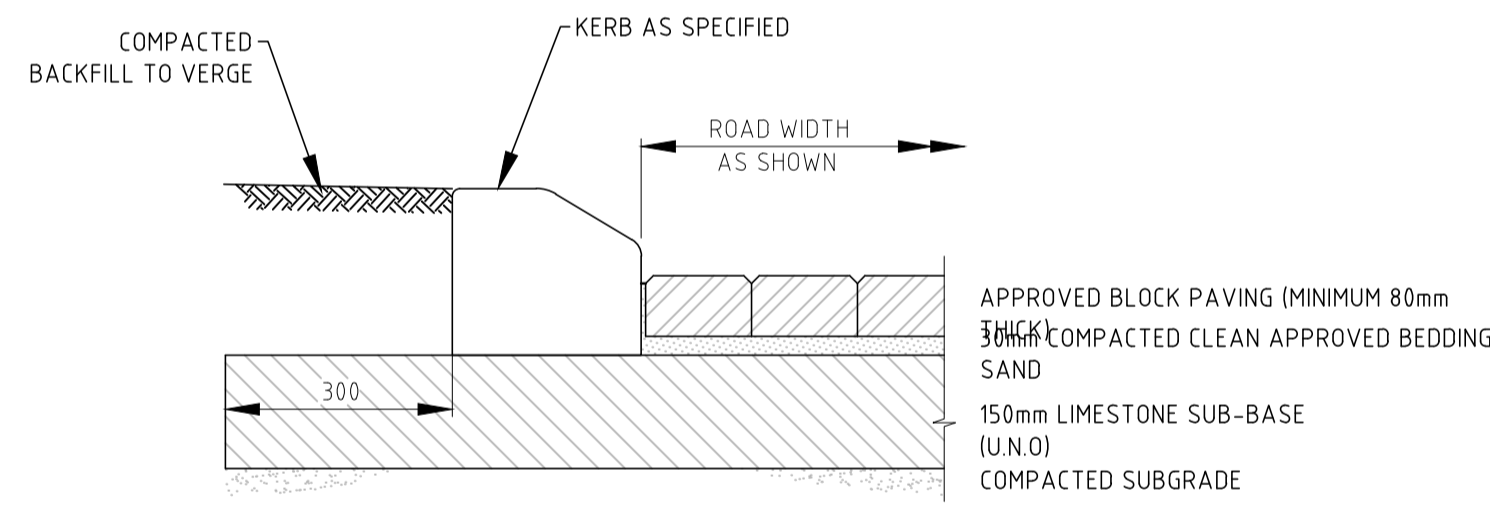

**PAVEMENT DETAIL - BRICK PAVING**  
N.T.S

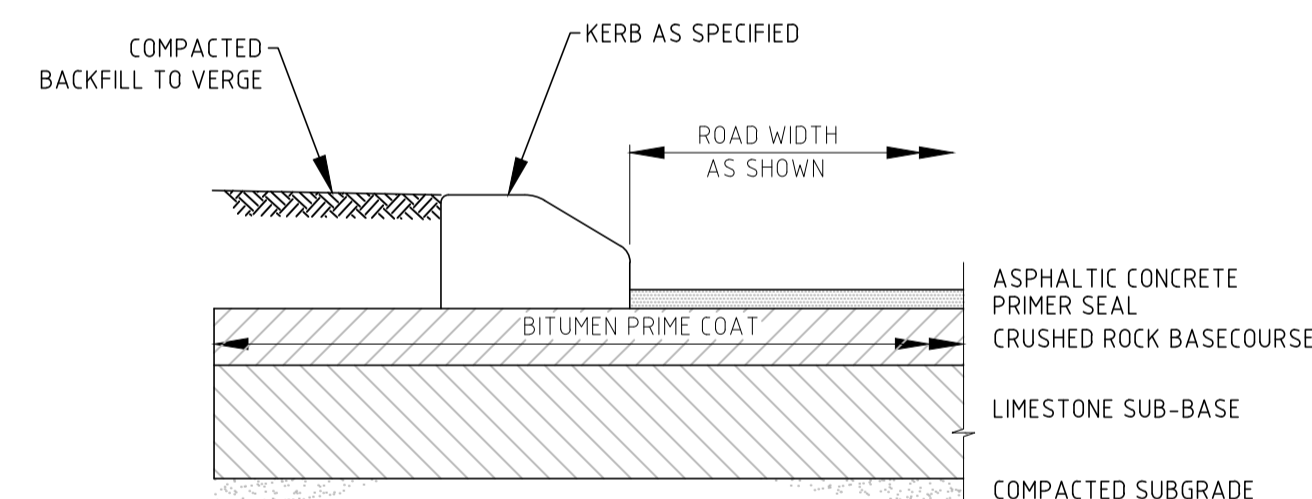


**PAVEMENT DETAIL - ASPHALTIC CONCRETE**  
N.T.S

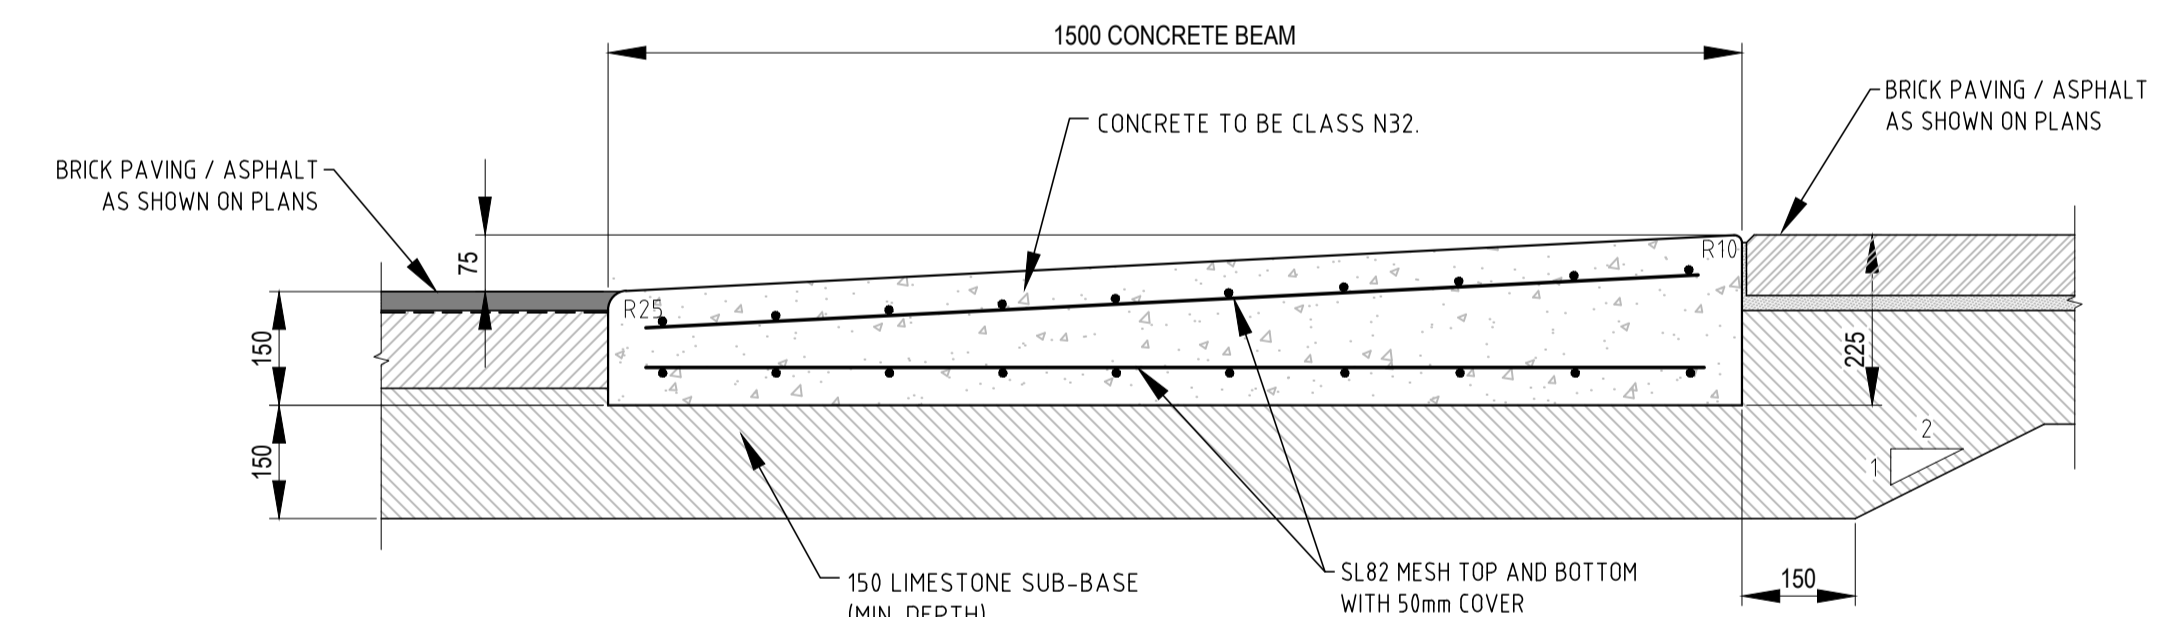


**1.5m WIDE REINFORCED FLUSH RAMP - EDGE BEAM (FK3)**  
N.T.S

**NOTES:**

- 1) FLUSH KERB, CONCRETE & ROAD KERB TO BE CAST MONOLITHICALLY.
- 2) FOR EXPANSION & JOINTING DETAILS REFER TO STANDARD DRAWING NUMBER STD-R05.

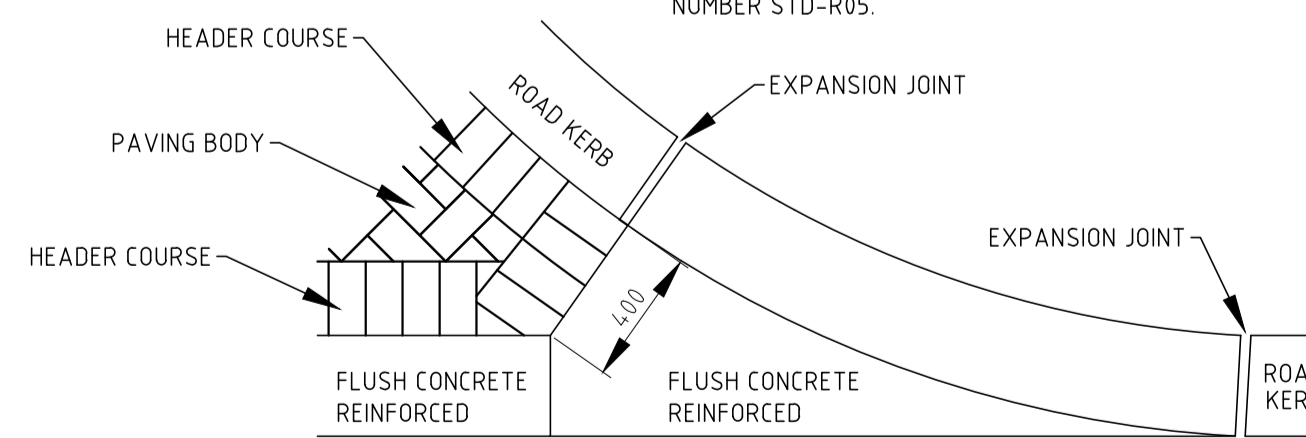

**EYEBROW KERB TRANSITION DETAIL**  
N.T.S

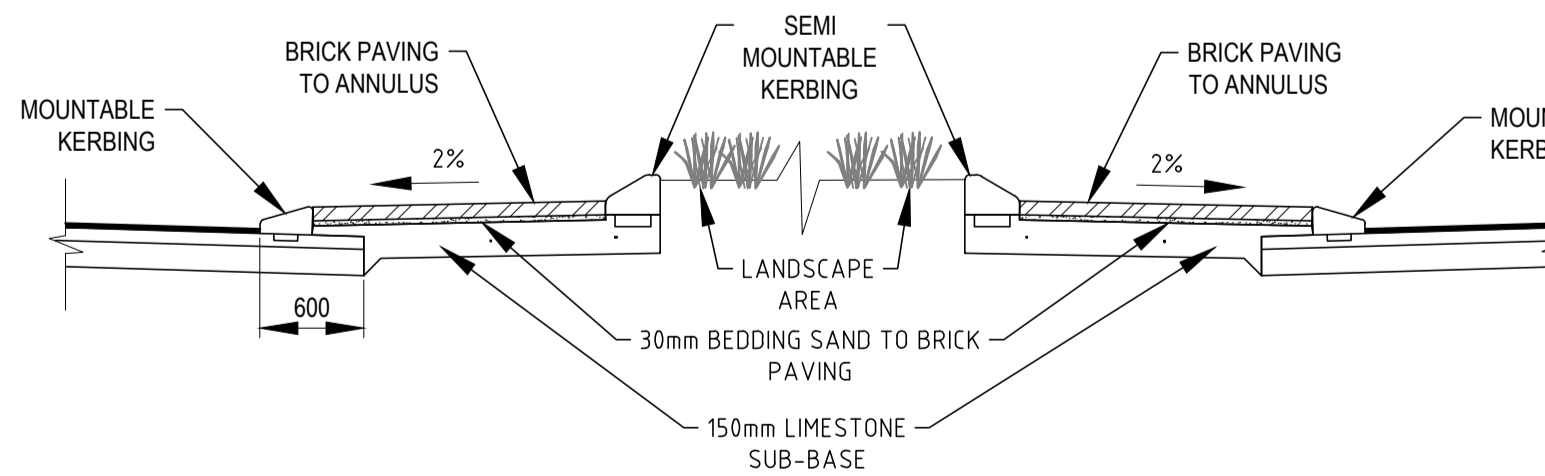

**TYPICAL SECTION THROUGH ROUNDABOUT**  
N.T.S

**KERB NOTES:**

1. CONCRETE FOR KERBING SHALL BE CONFORM TO AS 1379.
2. ALL KERBING IS TO INCLUDE POLYPROPYLENE FIBRE MICRO-REINFORCEMENT (MASTERFIBRE 22). THE RECOMMENDED DOSAGE IS 0.9KG PER CUBIC METRE OF CONCRETE ADDED.
3. MINIMUM COMPRESSIVE STRENGTH 32MPa AT 28 DAYS.
4. MAXIMUM AGGREGATE SIZE 10mm.
5. MAXIMUM SLUMP 50mm.
6. ALL KERBS TO BE KEYED(150 x 50mm) ON CURVE RADII LESS THAN 40m.
7. REINFORCEMENT TO BE STRUCTURAL GRADE STEEL COMPLYING WITH AS1302 GRADE 410Y.
8. NEW KERBING TO BE PROTECTED FROM TRAFFIC FOR A MINIMUM OF 7 DAYS AFTER INSTALLATION.
9. REFER TO STANDARD DRAWING NUMBER STD-R05 FOR TYPICAL EXPANSION & JOINTING DETAILS.

Engineering Standards Details\Standards\STD-R01 - EXTRUDED KERBING AND PAVEMENT DETAILS.dwg

| Amendments |          | Scale             | Date | By | Approved |
|------------|----------|-------------------|------|----|----------|
| AS SHOWN   |          |                   |      |    |          |
| N/A        |          |                   |      |    |          |
| A          | 30/11/23 | ISSUED FOR REVIEW |      | BV | NS       |
| No         | Date     | Revision          |      | By | Approved |



THIS DRAWING REMAINS THE PROPERTY OF THE SHIRE OF SERPENTINE JARRAHDALE AND SHALL NOT BE RETAINED, COPIED, OR USED, WITHOUT WRITTEN APPROVAL FROM THE DIRECTOR ENGINEERING SERVICES

| Drawn    | Date     | Signat |
|----------|----------|--------|
| BC       | 30/11/23 |        |
| Designat | Date     | Signat |
| BV       | 30/11/23 |        |
| Checked  | Date     | Signat |
| VB       | 30/11/23 |        |

Project: SHIRE OF SERPENTINE JARRAHDALE STANDARD DRAWINGS

Sheet No: 1 OF 1  
Revision No: A  
DWG No: STD-R01